

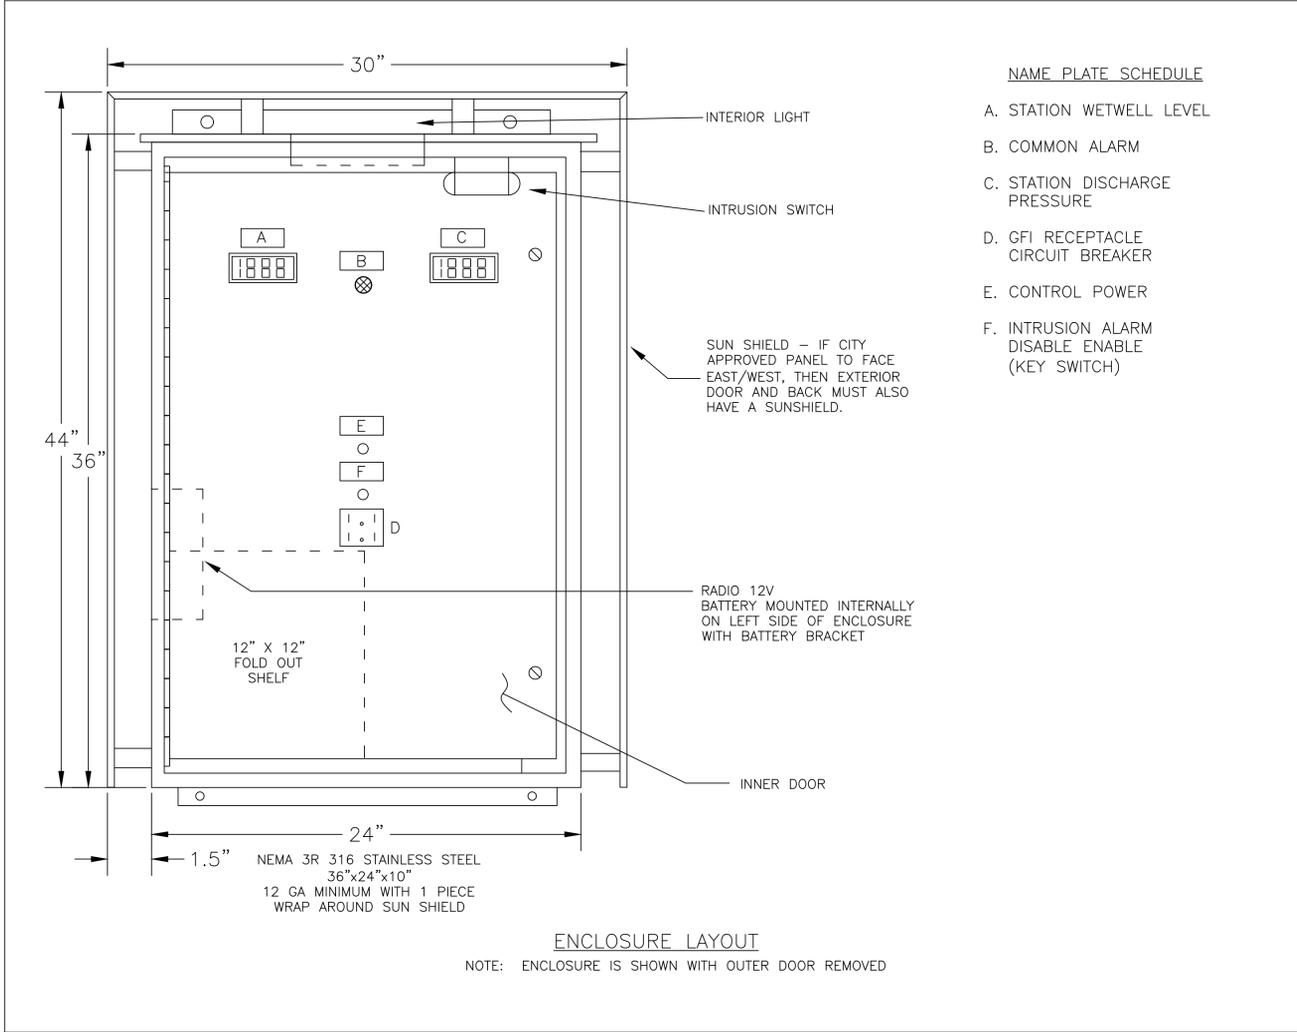
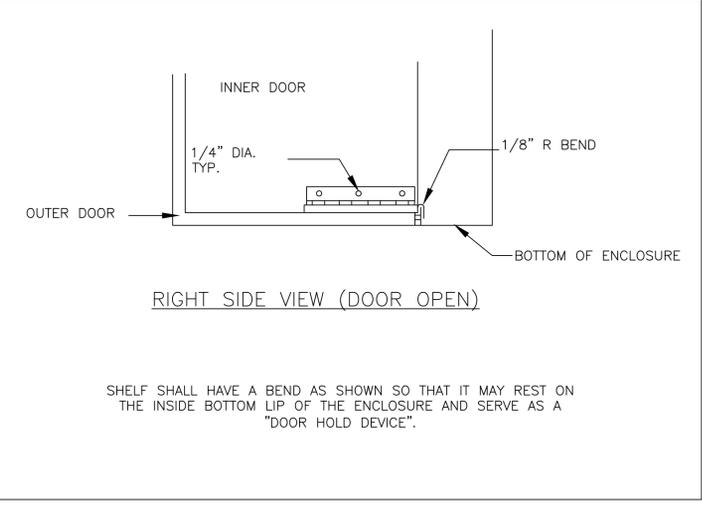


BACK PANEL LAYOUT  
MATERIAL: 14 GA CRS  
FINISH: WHITE ENAMEL

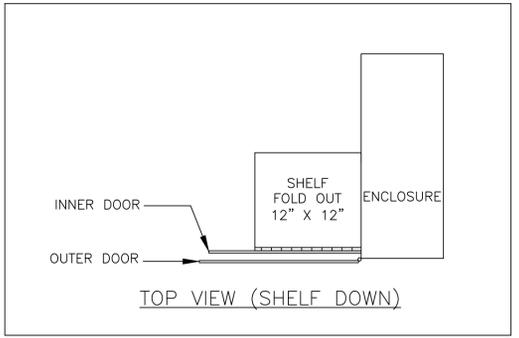

ENCLOSURE LAYOUT  
NOTE: ENCLOSURE IS SHOWN WITH OUTER DOOR REMOVED

- NAME PLATE SCHEDULE
- A. STATION WETWELL LEVEL
  - B. COMMON ALARM
  - C. STATION DISCHARGE PRESSURE
  - D. GFI RECEPTACLE CIRCUIT BREAKER
  - E. CONTROL POWER
  - F. INTRUSION ALARM DISABLE ENABLE (KEY SWITCH)



LEAVE BLANK - FOR CITY USE ONLY

48 HOURS BEFORE DIGGING  
BROWARD • PALM BEACH • INDIAN RIVER  
ST. LUCIE • MARTIN COUNTIES  
CAL. SOL. FIRE  
1-800-432-4770  
SUNSHINE STATE 1 CALL  
UNDERGROUND UTILITIES  
NOTIFICATION CENTER

Designed By:				
Drawn By:				
Checked By:				
SYMBOL	NO.	DATE	REVISIONS	CITY BY
	2	08/08	UPDATE TO ALL DETAILS	FV
	1	04/04	UPDATE TO ALL DETAILS	



APPROVED BY: \_\_\_\_\_ DATE: \_\_\_\_\_  
REGISTERED ENGINEER NO. \_\_\_\_\_  
STATE OF FLORIDA

PLC/RTU PANEL

ORIGINAL ISSUE DATE: 04/10/98	PROJECT NUMBER
NOT TO SCALE	2 / 5